


3/15/2011
Pedro P. Herrera

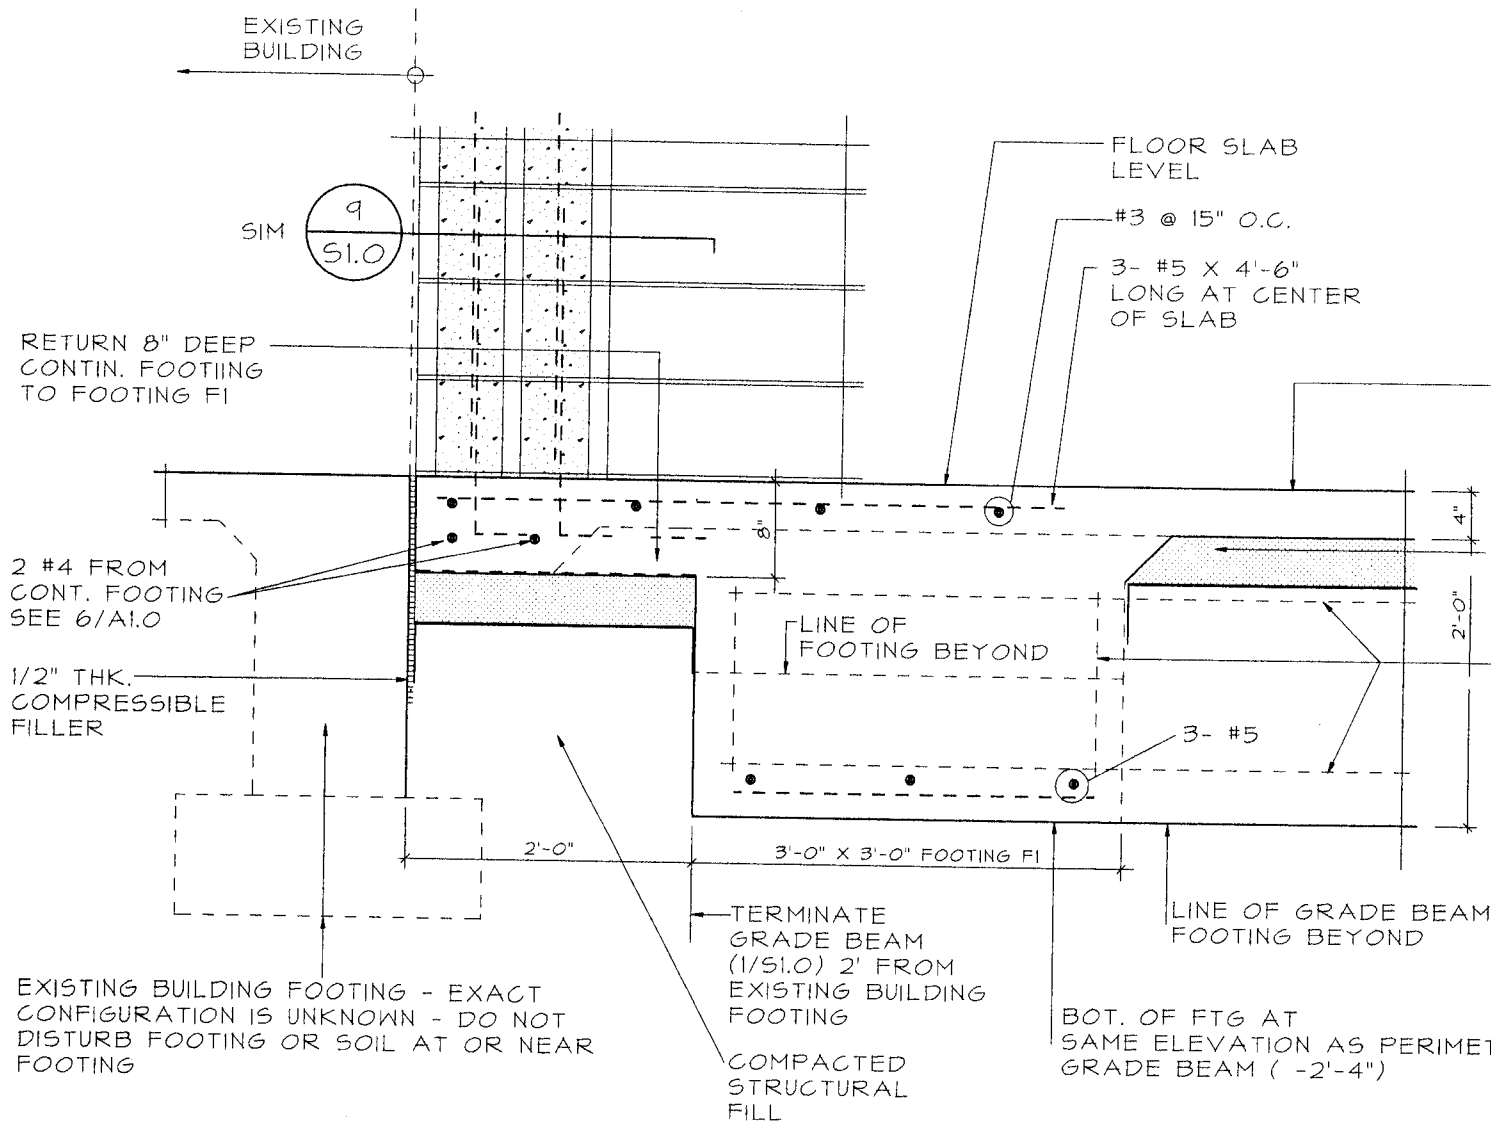

TYPICAL SLAB CONSTRUCTION:
 4" THK, 3000 PSI CONC.
 REINF. WITH #3 AT 15" O.C.E.W. - (REINF. NOT SHOWN)

4" SAND CUSHION OVER 6 MIL VAPOR BARRIER - ALL JOINTS TAPED
 GRADE BEAM REINF. INTO FOOTING

EXISTING BUILDING FOOTING - EXACT CONFIGURATION IS UNKNOWN - DO NOT DISTURB FOOTING OR SOIL AT OR NEAR FOOTING

2 #4 FROM CONT. FOOTING SEE 6/A1.0
 1/2" THK. COMPRESSIBLE FILLER

BOT. OF FTG AT SAME ELEVATION AS PERIMETER GRADE BEAM (-2'-4")

FOOTING F-1
SECTION
 5A
 S1.0

N.T.S.

RENOVATION OF THE ASCARATE PARK PAVILION BUILDING
 6900 DELTA, EL PASO

ADDENDUM DRAWING NO: 3-16-11

SMS
 ARCHITECTS

7500 VISCOUNT SUITE 125
 EL PASO, TEXAS 79925
 (915) 779-3048
 FAX (915) 775-0703